

XaYýô æþ&©,•q-I P×¨••.š

8VIBO (VJEF %SJWF 4DJFODF BOE 5FDIOPMPHZ \$P -UE

3Ð3âö@XaYý%1]7N•I Q Bî.~rg|A 6ûq-I 3ig|A 3i™_ .™

E Q,ö@

&©m!ö@

| 3âö@XXX HEFUFDPN

*"3•| % PÜ,wa÷{êö®

ô æþI Q <‡NjD-Ö ô æþI Q ••.š| sÇ

I Q l×R]7•P×.iP¬æ²E.% .•f•`ns

d·Q9H|P× hXaYýô æþ&©,•q-I P×¨••.š

\$PQZSJH#MIBO (VJEF %SJWF 4DJFODF BOE 5FDIOPMPHZ \$P -UE




) ' 1 - \$ % # 9 9 9 9 9

6kV					
	(A)	(kW)	W*D*H(mm)		(T)
HF6000-315-060/060-DB-M	30	250	2450*1350*2100	B1	2.0
HF6000-355-060/060-DB-M	34	280			2.1
HF6000-400-060/060-DB-M	38	315			2.2
HF6000-450-060/060-DB-M	43	355			2.3
HF6000-500-060/060-DB-M	48	400			2.3
HF6000-560-060/060-DB-M	54	450			2.4
HF6000-630-060/060-DB-M	61	500			2.4
HF6000-710-060/060-DB-M	68	560			2.5
HF6000-800-060/060-DB-M	77	630	2750*1350*2000	B2	2.7
HF6000-900-060/060-DB-M	87	710			2.9
HF6000-1000-060/060-DB-M	96	800			3.0
HF6000-1120-060/060-DB-M	108	900			3.2
HF6000-1250-060/060-DB-M	120	1000			3.4
HF6000-1400-060/060-DB-M	135	1120			3.6
HF6000-1600-060/060-DB-M	154	1250			3.8
HF6000-1800-060/060-DB-M	173	1400	2900*1550*2100	B3	4.2
HF6000-2000-060/060-DB-M	192	1600			4.5
HF6000-2250-060/060-DB-M	217	1800			4.7
HF6000-2500-060/060-DB-M	241	2000			5.1
HF6000-2800-060/060-DB-M	269	2250			5.4

		3 6kV	3 10kV
		6kV/10kV±10%	-10%~-35%
		50/60Hz	
		690V	
		≥0.96	20%~100%
		IEEE519-2014 GBT14549-93	
		0-6kV	0-10kV
		315-2800kVA	250-4500kVA
		0~50Hz/60Hz MAX120Hz 120~700Hz	
		≤2%	
		1	2
		100 1	1000 1
		DSP FPGA ARM	
		HMI	/
		±0.4%	±0.1%
		0.1~6500.0	
		120%/1min	
		Modbus	RS485 PROFIBUS-DP PROFINET
		10	
		8	
		2	4~20mA
		4	4~20mA 2 4~20mA/0~10V 2

1

0.1~1

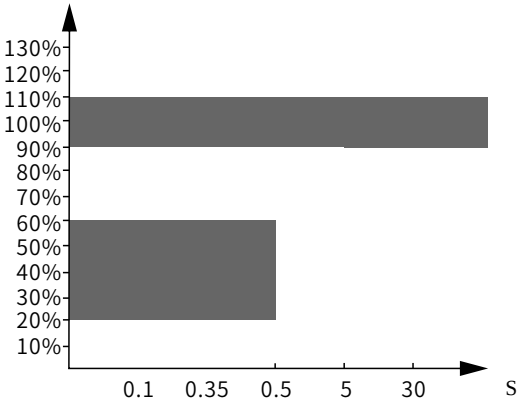

4

A A
CAN
B B

2

2

5 90% 8 92%

5

“ ” “ ”

3

9

380VAC 1 380VAC 1

10

7

“ - ” 10kV/6kV、50Hz 10kV/6kV


8

MODBUS-RTU RS485 PROFIBUS

1



2

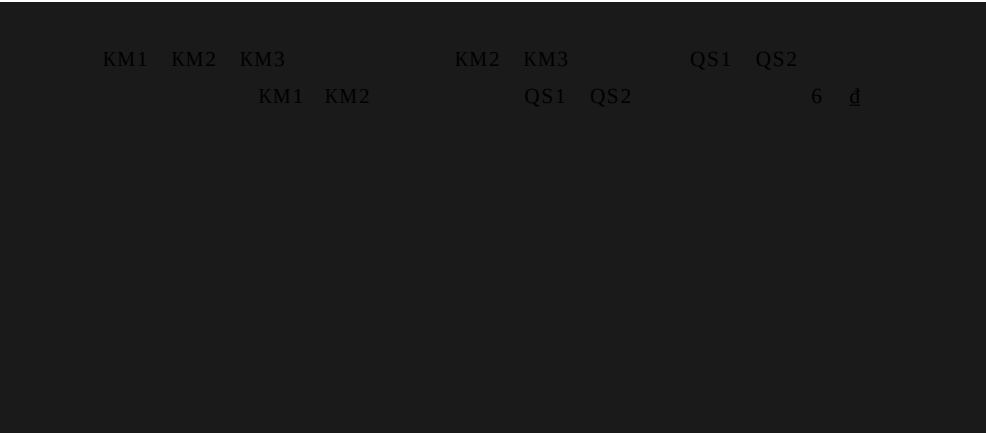

1.故障响应服务：

7×24
48

30

24

2.技术支持服务：

.

U

U

q

N

ž

L

